




TEMPERATURE CONTROLLERS... PORTABLE CHILLERS... CENTRAL CHILLERS... PUMP TANK STATIONS... TOWER SYSTEMS...


SUBJECT: SERPENTINE VS. MANIFOLDED SET-UPS

#7-A-69

10/7/1994

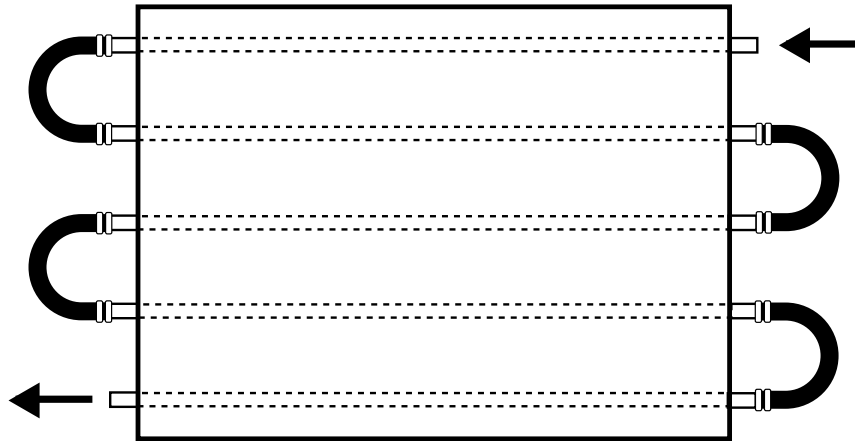

- Poor heat transfer
- High pressure drop
- High ΔT
- Restricted flow

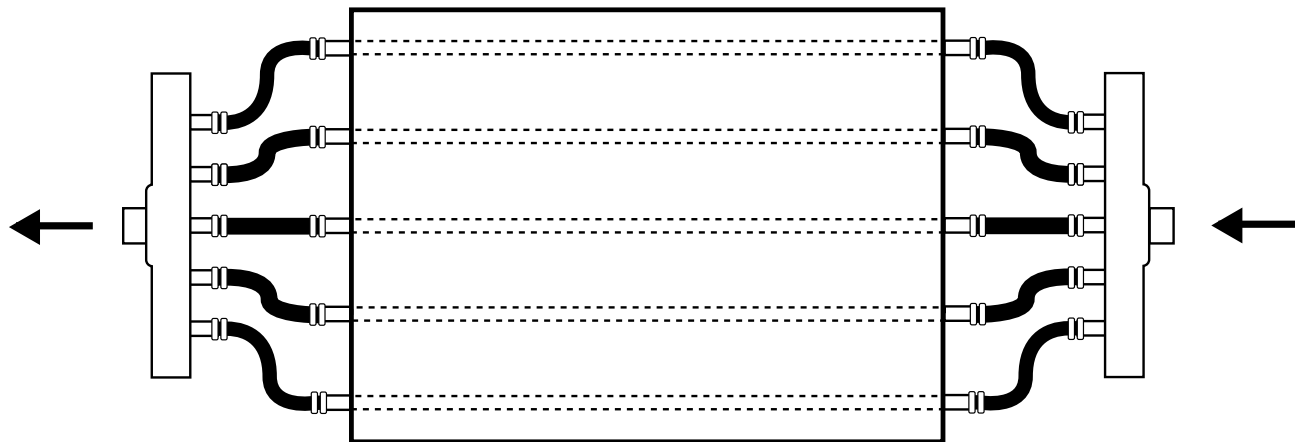

- Excellent heat transfer
- High flow
- Low ΔT
- Low pressure drop